


Electrical First Floor
1/4" = 1'-0"

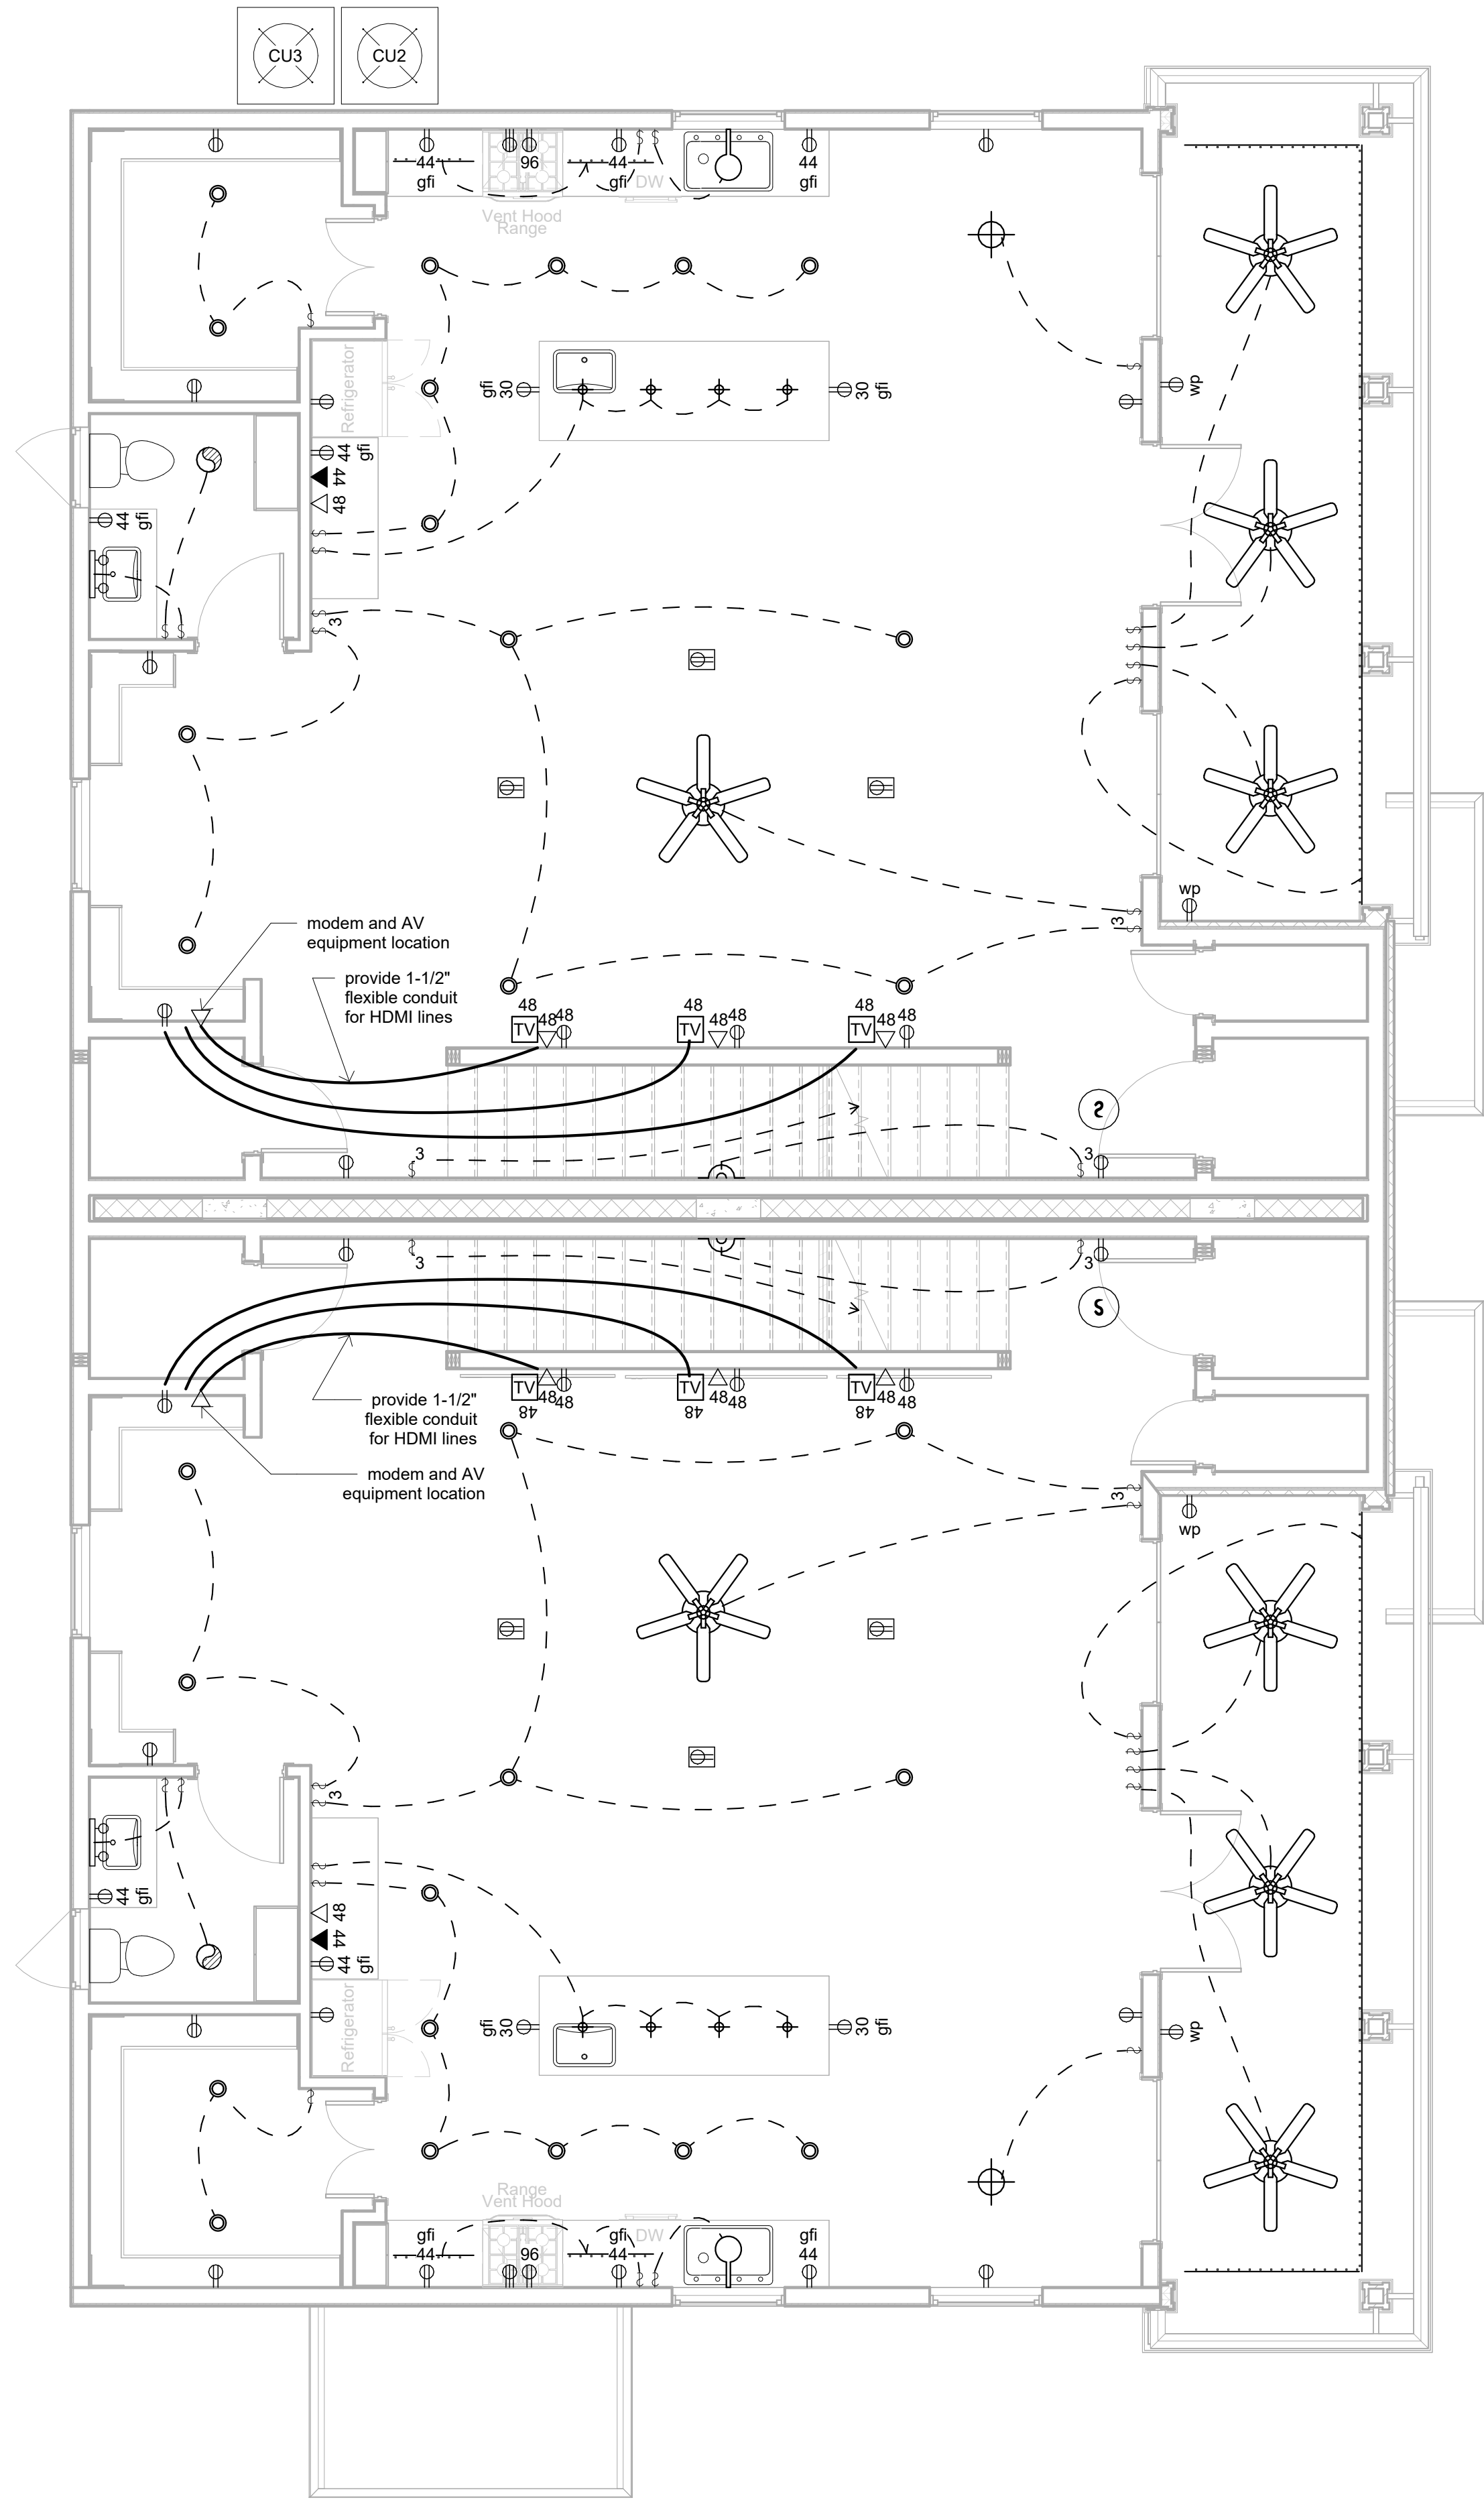

Electrical Second Floor
1/4" = 1'-0"

	Ceiling Fan
	Recessed Can Light
	Bathroom Vanity Light
	LED Strip Light - Provide all LED with Dimmable Drivers
	Mini Pendant
	Indirect Wall Mounted Light
	Ceiling Mounted Light
	Light Switch
	3 Way Light Switch
	Exhaust Fan Switch
	120V Duplex - Number indicates height above floor
	120V Duplex - Ground Fault Interrupted
	120V Duplex - Ground Fault Interrupted In Water Resistant Enclosure
	CAT6 Data Connection
	Telephone Connection
	RJ6 Television Connection
	Exhaust Fan
	Smoke and CO2 Combo Detector


Electrical Genral Notes:
1. All receptacle outlets not indicated as gfi (ground fault interrupted) shall be afci (arc fault circuit interrupted)
2. All receptacle outlets indicated as WP are Ground Fault Interrupted
3. Verify w/ Owner light fixtures to receive dimmers
4. Home run all CAT6 data connections to router location. Provide data connection to outside for Cable, Satellite and DSL Internet.

AA002909 PH/FAX 352-3782518
vraymos@gmail.com
www.architectvraymos.com
4825 SW 19th Street
Gainesville FL 32608

SUBCONTRACTORS AND CONTRACTORS SHALL BE IN CONFORMANCE WITH APPLICABLE CITY, COUNTY, STATE AND FEDERAL CODES. ALL DISCREPANCIES WITH CONSTRUCTION DOCUMENTS SHALL BE BROUGHT TO THE ARCHITECT'S ATTENTION PRIOR TO PROCEEDING. VERIFY ALL FIELD CONDITIONS AND DIMENSIONS.;

THIS DRAWING IS PROTECTED BY COMMON LAW COPY RIGHTS AND MAY NOT BE REPRODUCED IN ANY WAY WITHOUT THE WRITTEN CONSENT OF THE ARCHITECT. CHANGES TO THE DRAWING MAY ONLY BE MADE BY THE ARCHITECT. ANY OTHER CHANGES SHALL BE CONSTRUED AS A DEROGATION OF THE ARCHITECT'S COPY RIGHTS OR OTHER RESERVED RIGHTS.

VICTOR E RAYMOS JR.
ARCHITECT'S SEAL
NOT VALID WITHOUT ORIGINAL SIGNATURE, DATE & RAISED SEAL OR DIGITAL SEAL, DIGITAL SIGNATURE & DATE.



Gosslin Duplex
North Building 15136-015-003

Job Number: 574
Document Date: 07.17.2023

Rev	Date	Remark
-----	------	--------

Drafting by:
BOB HARRIS DESIGN
bobharrisdesign.com
bh@bobharrisdesign.com
352-317-6644
2351 SW 5th Avenue

Electrical Plan First & Second Floor

E1

OF
20

Permit Set

Permit Set